


CITY OF LAWTON

EXISTING SEWER SERVICE DISCONNECT
 DETAIL
 for
 NON-NEW CONSTRUCTION AND
 DEMOLITION PROJECTS

Wastewater Maintenance Division
 (580)581-3422

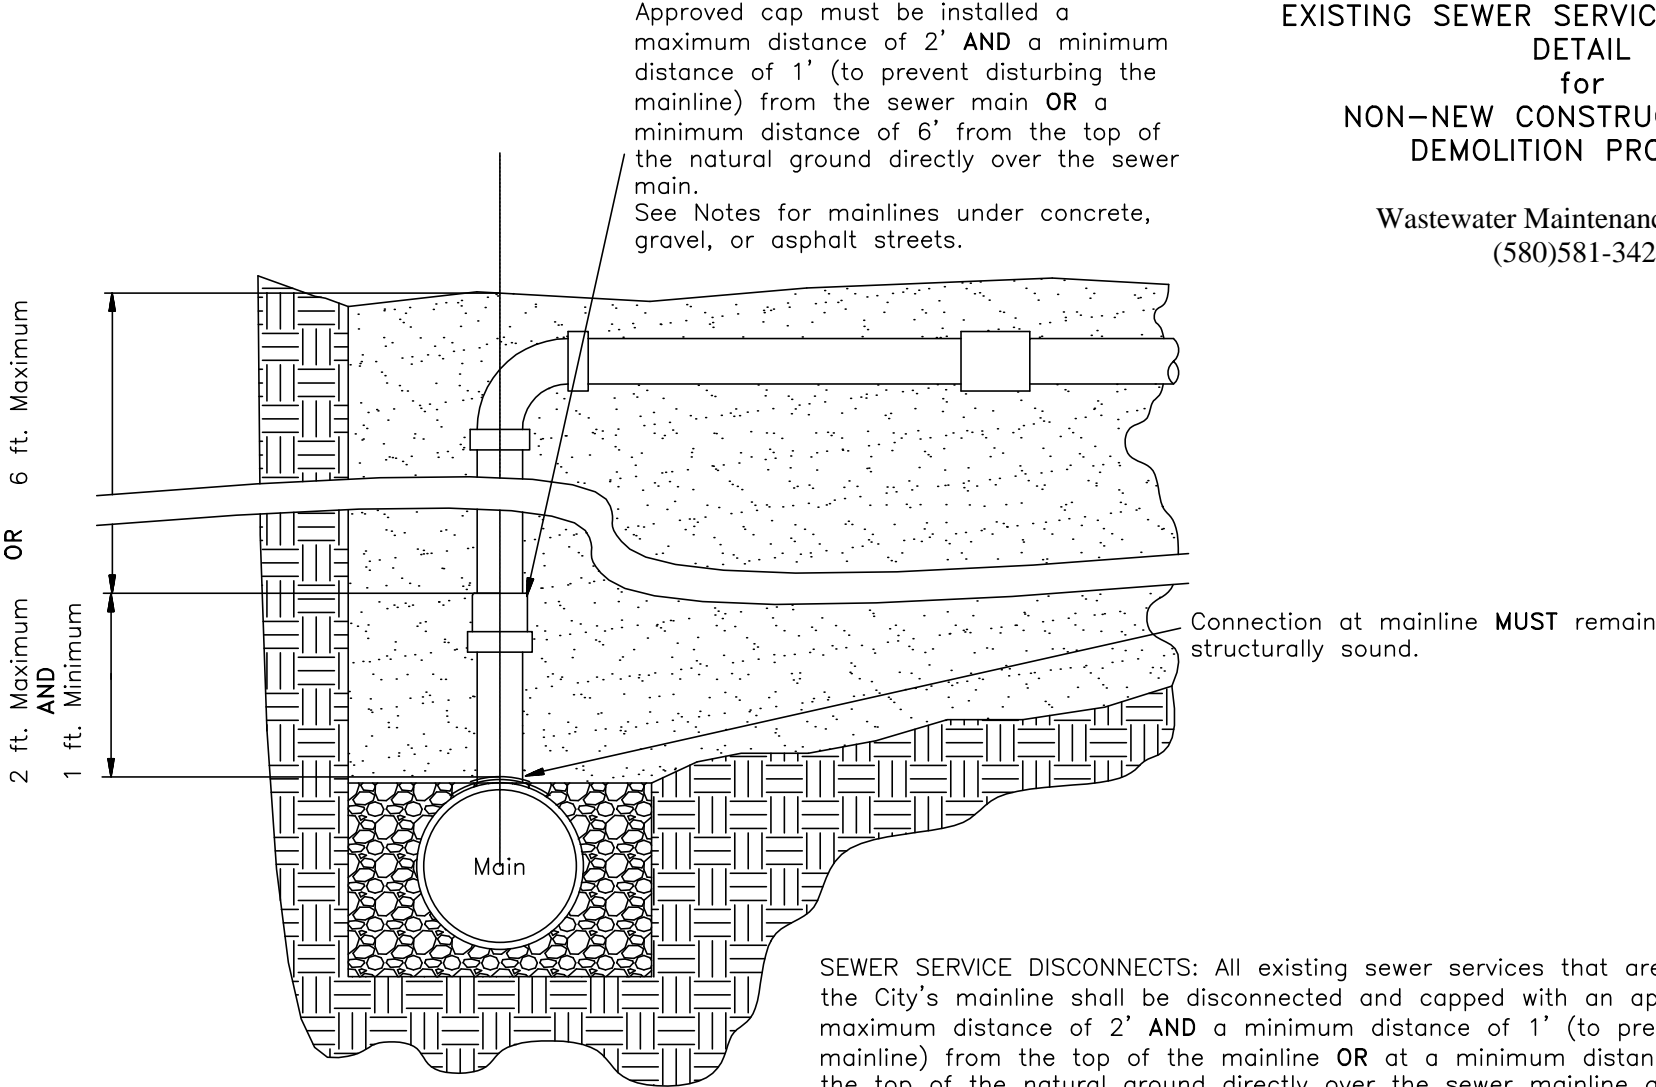

Detail No. 11

EXISTING SEWER SERVICE DISCONNECT
 (NON-NEW CONSTRUCTION AND DEMOLITION)

SEWER SERVICE DISCONNECTS: All existing sewer services that are disconnected from the City's mainline shall be disconnected and capped with an approved cap at a maximum distance of 2' AND a minimum distance of 1' (to prevent disturbing the mainline) from the top of the mainline OR at a minimum distance of 6 feet from the top of the natural ground directly over the sewer mainline as shown in detail NO.11. If the mainline exists under an asphalt OR concrete street, the service shall be disconnected no less than 2 feet AND no more than 3 feet from the edge of the existing gravel, asphalt, or concrete street. When, during the capping process, the vertical riser is observed to be structurally unsound (i.e. loose or moveable), the permittee MUST contact the City of Lawton Wastewater Maintenance Division to repair the mainline.